POWER MOVES®

2018 RESIDENTIAL REBATE PROGRAM

Geothermal Heat Pump (with Electric Backup)

- Closed loop ≥ 17.1 EER / ≥ 3.6 COP
- Open loop ≥ 21.1 EER / ≥ 4.1 COP
- Condenser and coil must be replaced and installed as a matched set

CLOSED LOOP, REPLACING: *electric resistance, fossil fuel, or into new construction*	$1,500
OPEN LOOP, REPLACING: *electric resistance, fossil fuel, or into new construction*	$1,500

Air Source Heat Pump - Split System (with Electric Backup)

- ≥ 16 SEER
- ≥ 9.0 HSPF
- Electric back up only
- Condenser and coil must be replaced and installed as a matched set
- New system must heat and cool entire home

REPLACING ELECTRIC RESISTANCE: *electric furnace, ceiling cable, baseboard*	$750
REPLACING FOSSIL FUEL: *propane or fuel oil*	$750
REPLACING EXISTING AIR SOURCE HEAT PUMP	$250

Mini-Split Air Source Heat Pump (with Electric Backup)

- ≥ 20 SEER
- ≥ 10.3 HSPF
- Electric back up only
- Condenser and coil must be replaced and installed as a matched set

REPLACING ELECTRIC RESISTANCE: *electric furnace, ceiling cable, baseboard*	$300
REPLACING FOSSIL FUEL: *propane or fuel oil*	$300
REPLACING EXISTING AIR SOURCE HEAT PUMP	$300

Heat Pump Water Heater

- Minimum EF of 2.0.

REPLACING ELECTRIC RESISTANCE TANK	$400
NEW CONSTRUCTION	$400

PURCHASE RECEIPTS REQUIRED FOR ALL REBATE APPLICATIONS.

AHRI Certificates required for all geothermal, air source heat pump and heat pump water heater rebate applications.

Heat loss/heat gain calculations required for geothermal and air source heat pumps.

Failure to provide requested information may result in forfeiture of rebate.

All installations are subject to verification and/or inspection.

For full requirements, see applications.

REBATE PROGRAM ENDS DEC. 31, 2018 AND IS SUBJECT TO CHANGE WITHOUT NOTICE.

Visit PowerMoves.com or call your local electric cooperative's Energy Advisor for more information.

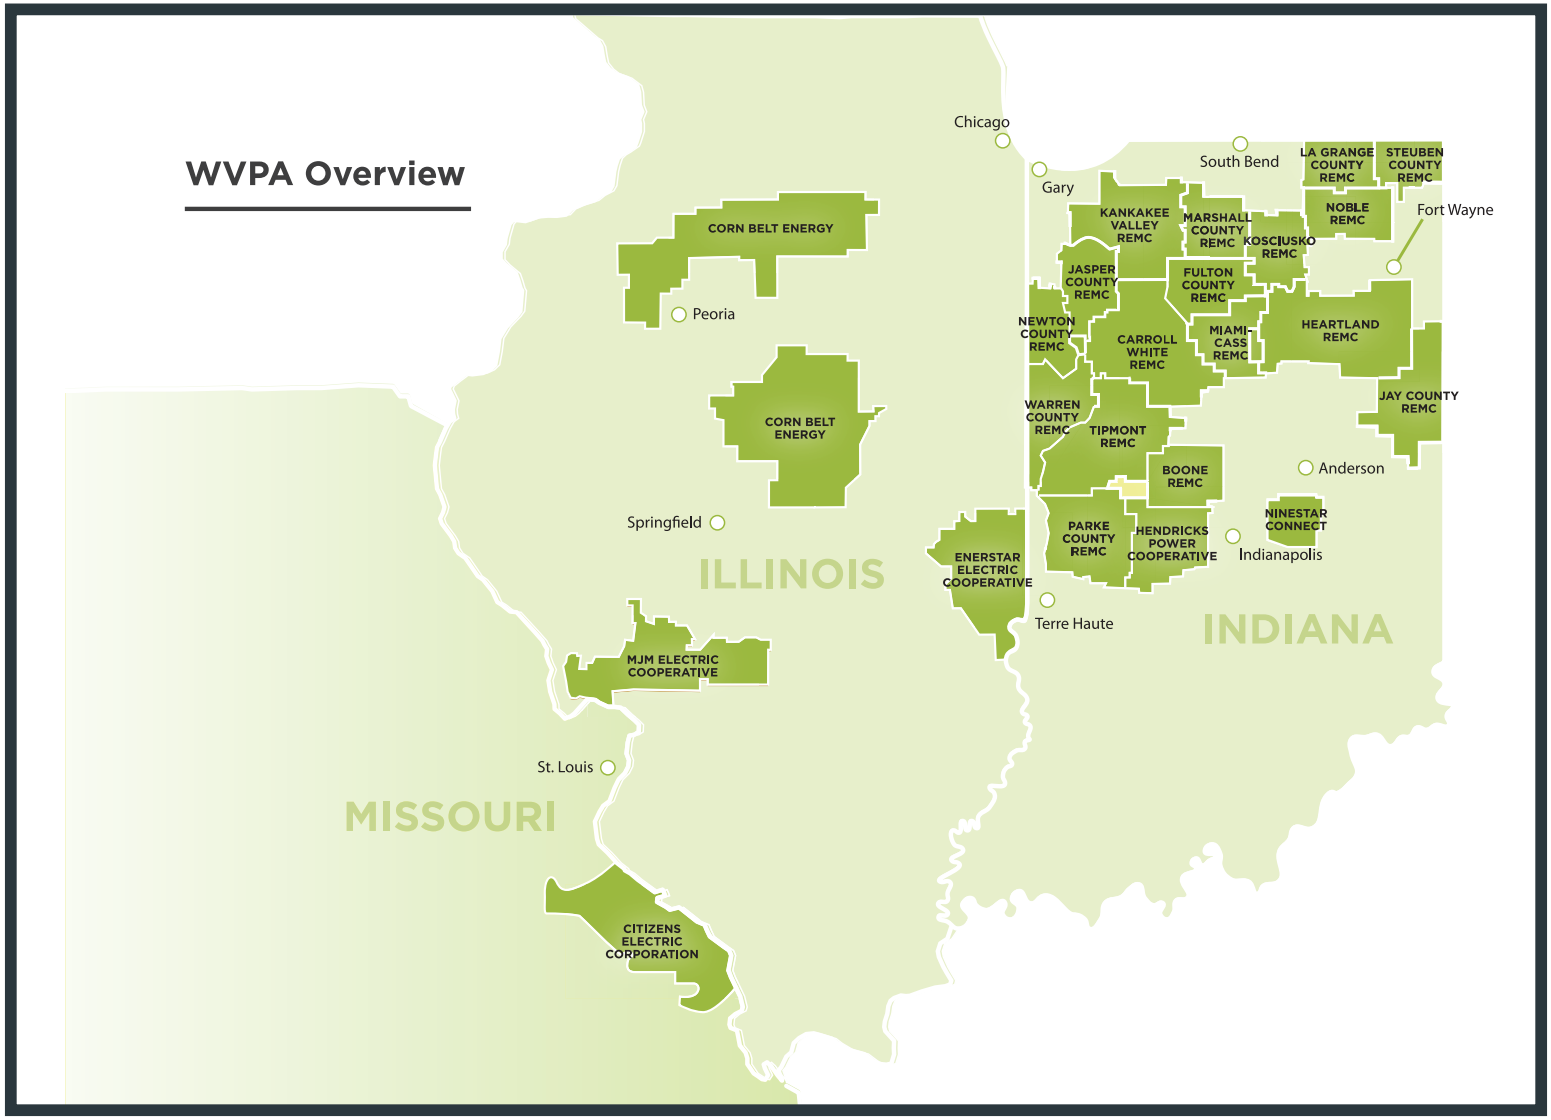

Visit PowerMoves.com or call your local electric cooperative's Energy Advisor for more information.